

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER) BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY PRODUCT CONTROL SECTION 11805 SW 26 Street, Room 208 Miami, Florida 33175-2474

T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

#### **NOTICE OF ACCEPTANCE (NOA)**

Mitsubishi Plastics Composites America, Inc. 401 Volvo Parkway Chesapeake, VA 23320

#### Scope:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION:** "Alpolic and Alpolic/FR" Composite Wall Panel Systems

**APPROVAL DOCUMENT:** Drawing No. MPCA0002, titled "Alpolic and Alpolic/fr Composite Wall Panel Systems", sheets 1 through 11 of 11, prepared by Mitsubishi Plastic Composites America, Inc., dated November 11, 2002, last revision #5, dated April 24, 2014, signed & sealed by Robert James Amoruso, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and the expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Small Missile Impact Resistant

**LABELING:** Each panel shall bear a permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA #12-0625.12 and consists of this page 1, evidence submitted pages E-1, E-2, E-3, & E-4 as well as approval document mentioned above.

The submitted documentation was reviewed by Helmy A. Makar, P.E., M.S.

MIAMI-DADE COUNTY APPROVED

Hely A. M. Expira 05/28/2015 Appro

NOA No. 14-0610.01 Expiration Date: 08/09/2017 Approval Date: 05/28/2015

Page 1

#### NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

#### 1. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 00-0315.07

#### A. DRAWINGS

1. Drawing No. 2, titled "Alpolic and Alpolic/FR Composite Wall Panel Systems", prepared by C. W. Stater, P.E., dated April 16, 1999, last revision #1 dated February 13, 2001, sheets 1 through 5 of 5, signed and sealed by C. W. Stater, P.E.

#### B. TESTS

- 1. Test report on **Small Missile Impact** Test, Cyclic Wind Pressure Test, and Uniform Static Air Pressure Test on Alpolic and Alpolic/FR Composite Wall Panel Systems, prepared by Architectural Testing Inc., Report No. 01-35789.02, dated 05/31/00, signed and sealed by Allen Reeves, P.E.
- 2. Test report on Ignition Properties, prepared by Southwest Research Institute, Report No. 01-8361-038, dated 10/28/96, signed by Betty J. Covey and Alex B. Wenzel.
- 3. Test report on Flame Spread Index and Smoke Developed Index, prepared by Southwest Research Institute, Report No. 01-7520-359a, dated 09/26/96, signed by Anthony L. Sauceda and Alex B. Wenzel.

#### C. CALCULATIONS

1. Calculations titled "Structural Calculations for Composite Panel System", pages 1 through 22 of 22, dated April 13, 2000, prepared by C. W. Stater, P.E., signed and sealed by C. W. Stater, P.E.

#### D. MATERIAL CERTIFICATIONS

- 1. Spec. Data issued by Alcoa Mill Products, dated November 08, 2000, with chemical composition and mechanical properties of Aluminum Alloy 3105-H14.
- 2. Tensile Test Report No 01-35789.03, prepared by Architectural Testing, dated July 07, 2000, signed and sealed by Allen N. Reeves, P.E.

#### 2. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #03-0130.06

#### A. DRAWINGS

 Drawing No. 1, titled "Alpolic and Alpolic/fr Composite Wall Panel Systems", sheets 1 through 10 of 10, prepared by Mitsubishi Chemical America, Inc., signed and sealed by Christopher W. Stater, P.E., dated November 11, 2002.

#### B. TESTS

1. Test report on Small Missile Impact Test, Cyclic Wind Pressure Test, and Uniform Static Air Pressure Test on Alpolic and Alpolic/FR Composite Wall Panel Systems, prepared by Architectural Testing Inc., Report No. 01-43055.01, dated January 07, 2003, signed and sealed by Joseph A. Reed, P.E.

Product Control Unit Supervisor

NOA No. 14-0610.01 Expiration Date: 08/09/2017

Approval Date: 05/28/2015

#### NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

- C. CALCULATIONS
  - 1. None.
- D. MATERIAL CERTIFICATIONS
  - 1. Tensile Test Report No 01-43055.02, prepared by Architectural Testing, dated March 04, 2003, signed and sealed by Joseph A. Reed, P.E.
- 3. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #06-0531.12
- A. DRAWINGS
  - 1. None.
- B. TESTS
  - None.
- C. CALCULATIONS
  - 1. None.
- D. QUALITY ASSURANCE
  - By Miami-Dade County Building Code Compliance Office.
- E. MATERIAL CERTIFICATIONS
  - 1. None.
- 4. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 09-0923.05
- A. DRAWINGS
  - 1. Drawing No. 1, titled "Alpolic and Alpolic/fr Composite Wall Panel Systems", sheets 1 through 10 of 10, prepared by Mitsubishi Chemical America, Inc., dated 11/11/02, last revision #1 dated 09/01/09, signed and sealed by Robert A. Walz, P.E.
- B. TESTS
  - 1. None.
- C. CALCULATIONS
  - 1. None.
- D. QUALITY ASSURANCE
  - 1. By Miami-Dade County Building Code Compliance Office.
- E. MATERIAL CERTIFICATIONS
  - 1. None.

Helmy A. Makar, P.E., M.S. Product Control Unit Supervisor

NOA No. 14-0610.01

**Expiration Date: 08/09/2017 Approval Date: 05/28/2015** 

#### NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

- 5. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 11-0421.08
- A. DRAWINGS
  - 1. None.
- B. TESTS
  - 1. None.
- C. CALCULATIONS
  - 1. None.
- D. QUALITY ASSURANCE
  - 1. By Miami-Dade County Building and Neighborhood Compliance Department.
- E. MATERIAL CERTIFICATIONS
  - 1. None.
- 6. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 12-0625.12
- A. DRAWINGS
  - 1. Drawing No. MPCA0002, titled "Alpolic and Alpolic/fr Composite Wall Panel Systems", sheets 1 through 11 of 11, prepared by Mitsubishi Plastic Composites America, Inc., dated November 11, 2002, last revision #4, dated June 10, 2012, signed & sealed by Robert James Amoruso, P.E., on November 08, 2012.
- B. TESTS
  - 1. Test report on **Small Missile Impact** Test, Cyclic Wind Pressure Test, and Uniform Static Air Pressure Test on Alpolic and Alpolic/FR Composite Wall Panel Systems, prepared by Architectural Testing Inc., Report No. 67392.01-109-18, dated October 27, 2006, signed and sealed by Joseph A. Reed, P.E., on May 30, 2012.
- C. CALCULATIONS
  - 1. Calculations titled "Installation Anchorage Analysis", pages 1 through 10 of 10, dated May 31, 2012, prepared by Robert James Amoruso, P.E., signed and sealed by Robert James Amoruso, P.E.
- D. OUALITY ASSURANCE
  - 1. By Miami-Dade County Department of Regulatory and Economic Resources.
- E. MATERIAL CERTIFICATIONS
  - 1. None.

Product Control Unit Supervisor

NOA No. 14-0610.01

Expiration Date: 08/09/2017

Approval Date: 05/28/2015

#### NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

#### 7. NEW EVIDENCE SUBMITTED

#### A. DRAWINGS

1. Drawing No. MPCA0002, titled "Alpolic and Alpolic/fr Composite Wall Panel Systems", sheets 1 through 11 of 11, prepared by Mitsubishi Plastic Composites America, Inc., dated November 11, 2002, last revision #5, dated April 24, 2014, signed & sealed by Robert James Amoruso, P.E., on April 24, 2014.

#### B. TESTS

1. None.

#### C. CALCULATIONS

1. None.

#### D. QUALITY ASSURANCE

1. By Miami-Dade County Department of Regulatory and Economic Resources.

#### E. MATERIAL CERTIFICATIONS

1. None.

#### F. OTHERS

1. Florida Building Code, 2014 Edition, compliance letter prepared by PTC, dated April 24, 2015, signed and sealed by Robert James Amoruso, P.E., on April 24, 2014.

Helmy A. Makar, P.E., M.S. Product Control Unit Supervisor

NOA No. 14-0610.01

**Expiration Date: 08/09/2017 Approval Date: 05/28/2015** 

# ALPOLIC and ALPOLIC/FR (FIRE RESISTIVE) COMPOSITE WALL PANEL SYSTEMS FOR SMALL MISSILE IMPACT

# **GENERAL NOTES**

- THESE ALPOLIC AND ALPOLIC/FR COMPOSITE PANELS SHALL BE USED FOR WALL CONSTRUCTION. SOFITS. AND OTHER EXTERIOR DETAILS WHOSE REQUIREMENTS FOR POSITIVE AND NEGATIVE PRESSURES ARE WITHIN THEN VALUES STATED IN NOTE 2 OF THIS DRAWING, EACH ACTUAL WALL PROJECT SHALL BE CONSTRUCTED USING THE DETAILS SHOWN ON THESE DRAWINGS AS MINIMUM REQUIRED SPECIFICATIONS
- THE WALL DESIGN ALLOWABLE PRESSURES FOR THESE WALL PANEL SYSTEMS ARE:
- KISTLER McDOUGALL EXTRUSIONS: + 153 PSF/ -153 PSF
- SAF METAL FABRICATION EXTRUSIONS: + 70 PSF/ -90 PSF.

3. THESE ALPOLIC and ALPOLIC/fr COMPOSITE WALL PANEL SYSTEMS ARE TESTED IN ACCORDANCE WITH THE FOLLOWING PROTOCOLS PER THE CURRENT EDITION OF THE FLORIDA BUILDING CODE:

TAS-201-94, IMPACT TEST, SMALL MISSILE TAS-202-94, UNIFORM STATIC AIR PRESSURE TEST TAS-203-94, CYCLIC WIND PRESSURE TEST

AND THEY SHALL BE INSTALLED AS SHOWN IN THESE APPROVED DRAWINGS.

# **MATERIAL SPECIFICATIONS:**

### **ALUMINUM EXTRUSIONS**

- MATERIAL: M2, F2, A2, HS, and HR ARE EXTRUDED ALUMINUM ALLOY 6063 WITH A T6 TEMPER By Kistler McDougall.
- MATERIAL: 37893 (CAY-1009) TEE, 37894 (CAY-1010) FEMALE, 37899 (CAY-1011) MALE, 38500B (CAY-1012) STIFFENER AND 38499A (CAY-1013) RETAINER ARE EXTRUDED ALUMINUM ALLOY 6063 WITH A T6 TEMPER By SAF Metal Fabication (FORMALLY CAY ARCHITECTURAL PRODUCTS).
- FINISH: MILL FINISH

## **COMPOSITE PANEL**

- ALPOLIC AND ALPOLIC/FR ALUMINUM COMPOSITE METAL PANEL 4MM THICK (0.157") AND 6MM THICK (0.236") AS MANUFACTURED BY MITSUBISHI PLASTICS COMPOSITES AMERICA, INC., CHESAPEAKE, VA
- CORE: THERMOPLASTIC MATERIAL WHICH IN COMPOSITE ASSEMBLY MEETS PERFORMANCE CHARACTERISTICS SPECIFIED.
- FACE SHEET: 0.020" ALUMINUM 3105-H14 ALLOY
- FINISH: FLUROPOLYMER RESIN COATING.
- MAXIMUM DIMENSIONS: 62" WIDE X 288" LONG
- TECHNICAL DATA

DESCRIPTION	TEST	4MM ALPOLIC	4MM ALPOLIC/fr	6MM ALPOLIC
SPECIFIC GRAVITY WEIGHT TENSILE STRENGTH YIELD STRENGTH ELONGATION PUNCHING SHEAR RESISTANCE (1"DIA.) PUNCHING SHEAR MAX LOAD BOND INTEGRITY VERTICAL PULL DRUM PEEL FLATWISE SHEAR RATE OF BURNING FLAME SPREAD INDEX SMOKE DEVELOPED INDEX SELF IGNITION TEMPERATURE FLASH IGNITION TEMPERATURE SURFACE FLAMMABILITY	ASTM E-8 ASTM E-8 ASTM E-8 ASTM D-732 ASTM D-732 ASTM D-1781-76 ASTM C-273 ASTM D-635 ASTM D-635 ASTM E-84 ASTM E-84 ASTM D-1929 ASTM D-1929 ASTM D-1929	1.38 1.12 LB/SQ.FT 7452 PSI NDY 16% 4025 PSI 1920 PSI 1806 PSI 33.6 IN-LB/IN 1225 PSI CC1 00 00 752°F 716°F PASSED	1.90 1.56 LB/SQ.FT 5693 PSI NDY 8% 4637 PSI 2259 PSI 427 PSI 27.6 IN-LB/IN 949 PSI  00 10 837°F 811°F PASSED	1.23 1.50 LB/SQ.FT 5399 PSI NDY 13% 2816 PSI 2121 LBS 1664 PSI 33.6 IN-LB/IN 1195 PSI  00 10 752°F 716°F PASSED
SOUND TRANSMISSION	ASTM E-413	STC-26		STC-26

## FRAMING & ACCESSORIES

- STEEL STUDS AND TRACKS: 16 GA. MIN. GALVANIZED STEEL WITH MIN. PROPERTIES OF 50 KSI YIELD, 65 KSI ULTIMATE.
- STUD & TRACK FASTENERS: #12 x 1-1/2" HEX WASHER HEAD HEAVY DUTY TEKS 4, 4.5, OR 5 BY ITW BUILDEX SCREW OR STUD & TRACK FASTENERS: #12 x 1-1/2" HEX WASHER HEAD TEKS SELECT BY ITW BUILDEX SCREW.
- PANEL FASTENERS: #10 x 1" HEX WASHER HEAD ITW BUILDEX TEK SCREWS SPACED AT 16" O.C.
- STIFFENER FASTENERS: #10 x 1" HEX WASHER HEAD ITW BUILDEX TEK SCREWS.
- JOINT SILICONE: DOW CORNING #795 SILICONE SEALANT.
- STRUCTURAL SILICONE: DOW CORNING #1199 SILICONE SEALANT.
- BACKER ROD: 3/4" DIA. DENVER FOAM OPEN CELL BACKER ROD.
- THE STRUCTURAL ADEQUACY OF THE 16 GA. GALVANIZED STEEL STUDS AND THE REST OF THE STRUCTURAL FRAMING SUPPORTING THE METAL PANELS IS NOT PART OF THIS PRODUCT CONTROL APPROVAL AND IT SHALL BE REVIEWED BY THE STRUCTURAL PLANS EXAMINER OF THE CORRESPONDING BUILDING DEPARTMENT.



Robert J. Amoruso, P.E.

FL P.E. No. 49752

9/01/09 GEN NOTE 1 VAS VALL CONSTRUCTION ON

as complying with the Florida Acceptance No 14-06 10.01



PTC PRODUCT DESIGN GROUP, LLC PO BOX 520775 ONGWOOD, FLORIDA 32752 EBPE C A NO 25935


MITSUBISHI PLASTICS COMPOSITES FRACTIONS ± 1/32 DATE APPROVALS


DO NOT SCALE DRAWING


ALPOLIC and ALPOLIC/fr COMPOSITE WALL PANEL SYSTEMS


AMERICA, INC.


MPGA0002 SHEET 1 OF 11

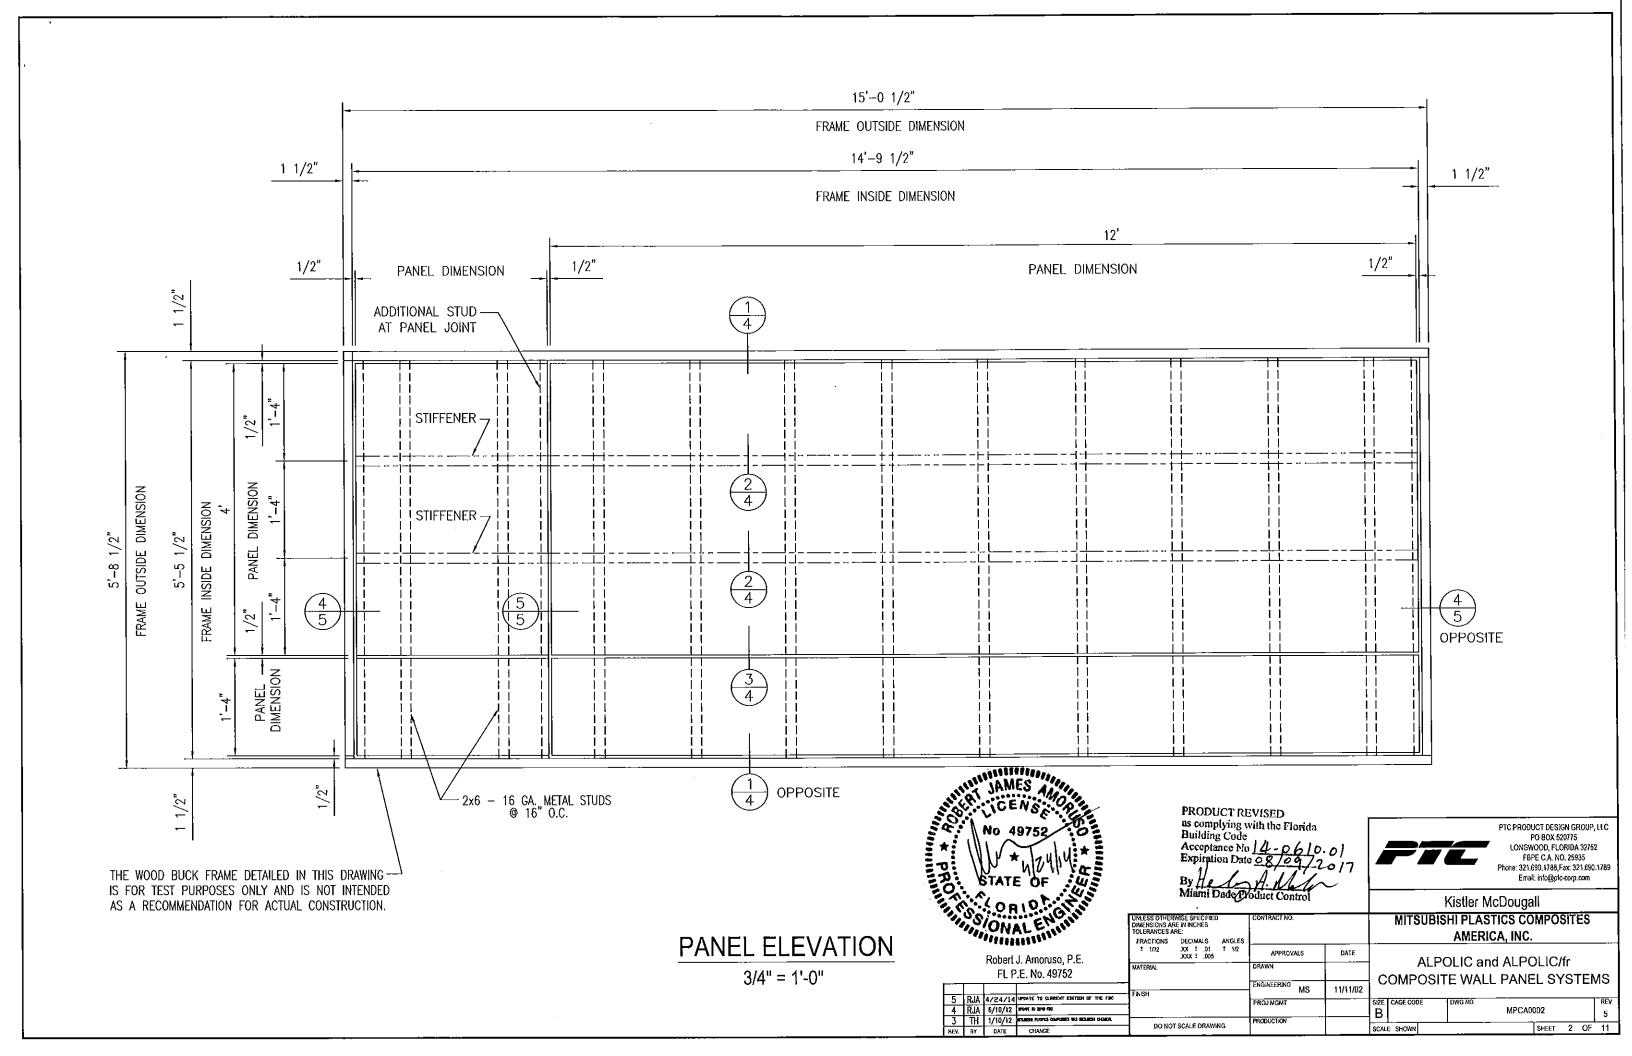

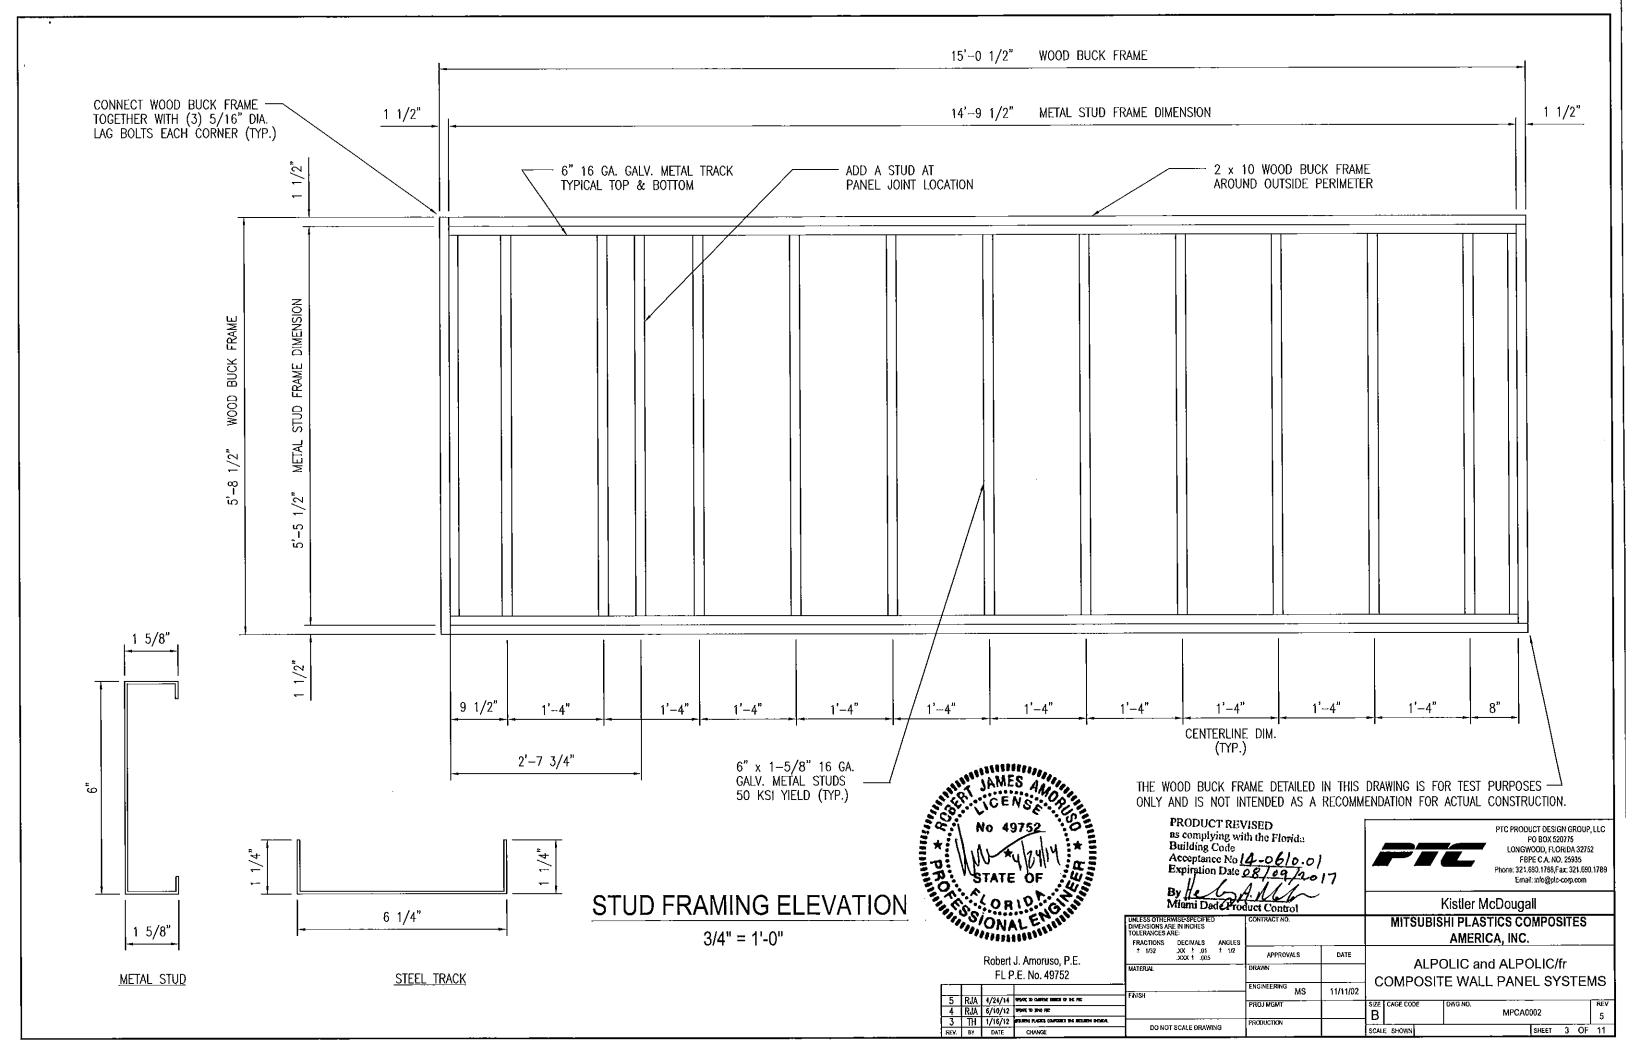

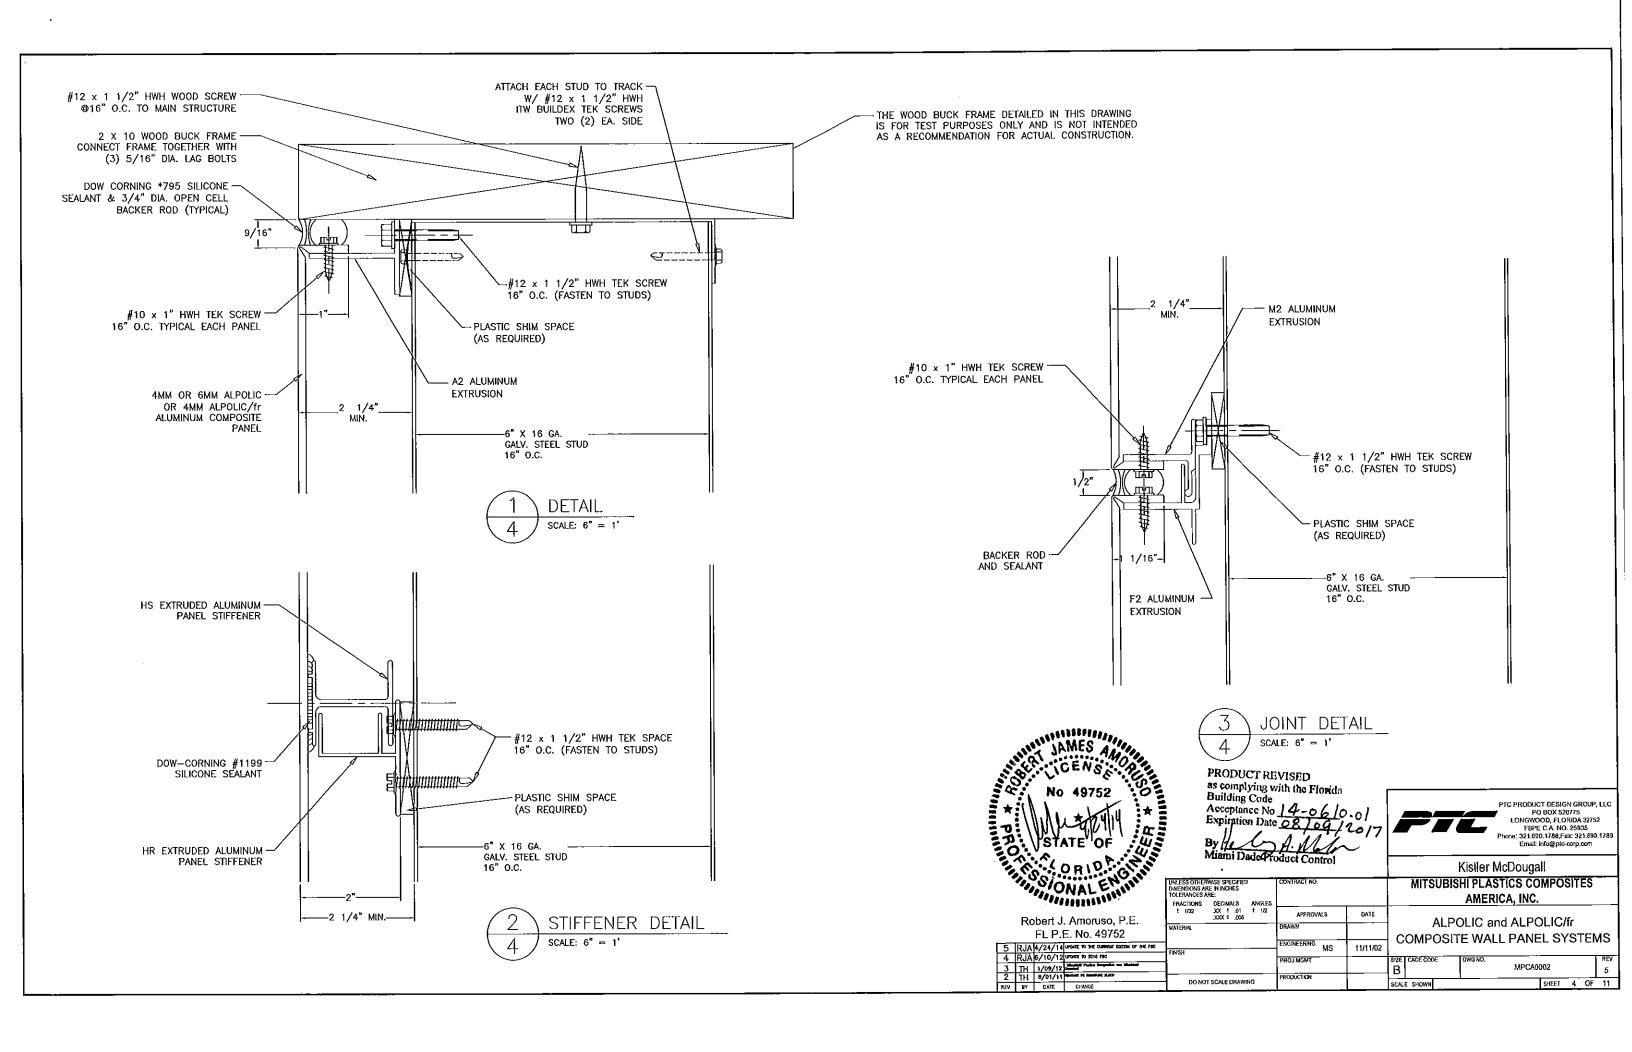

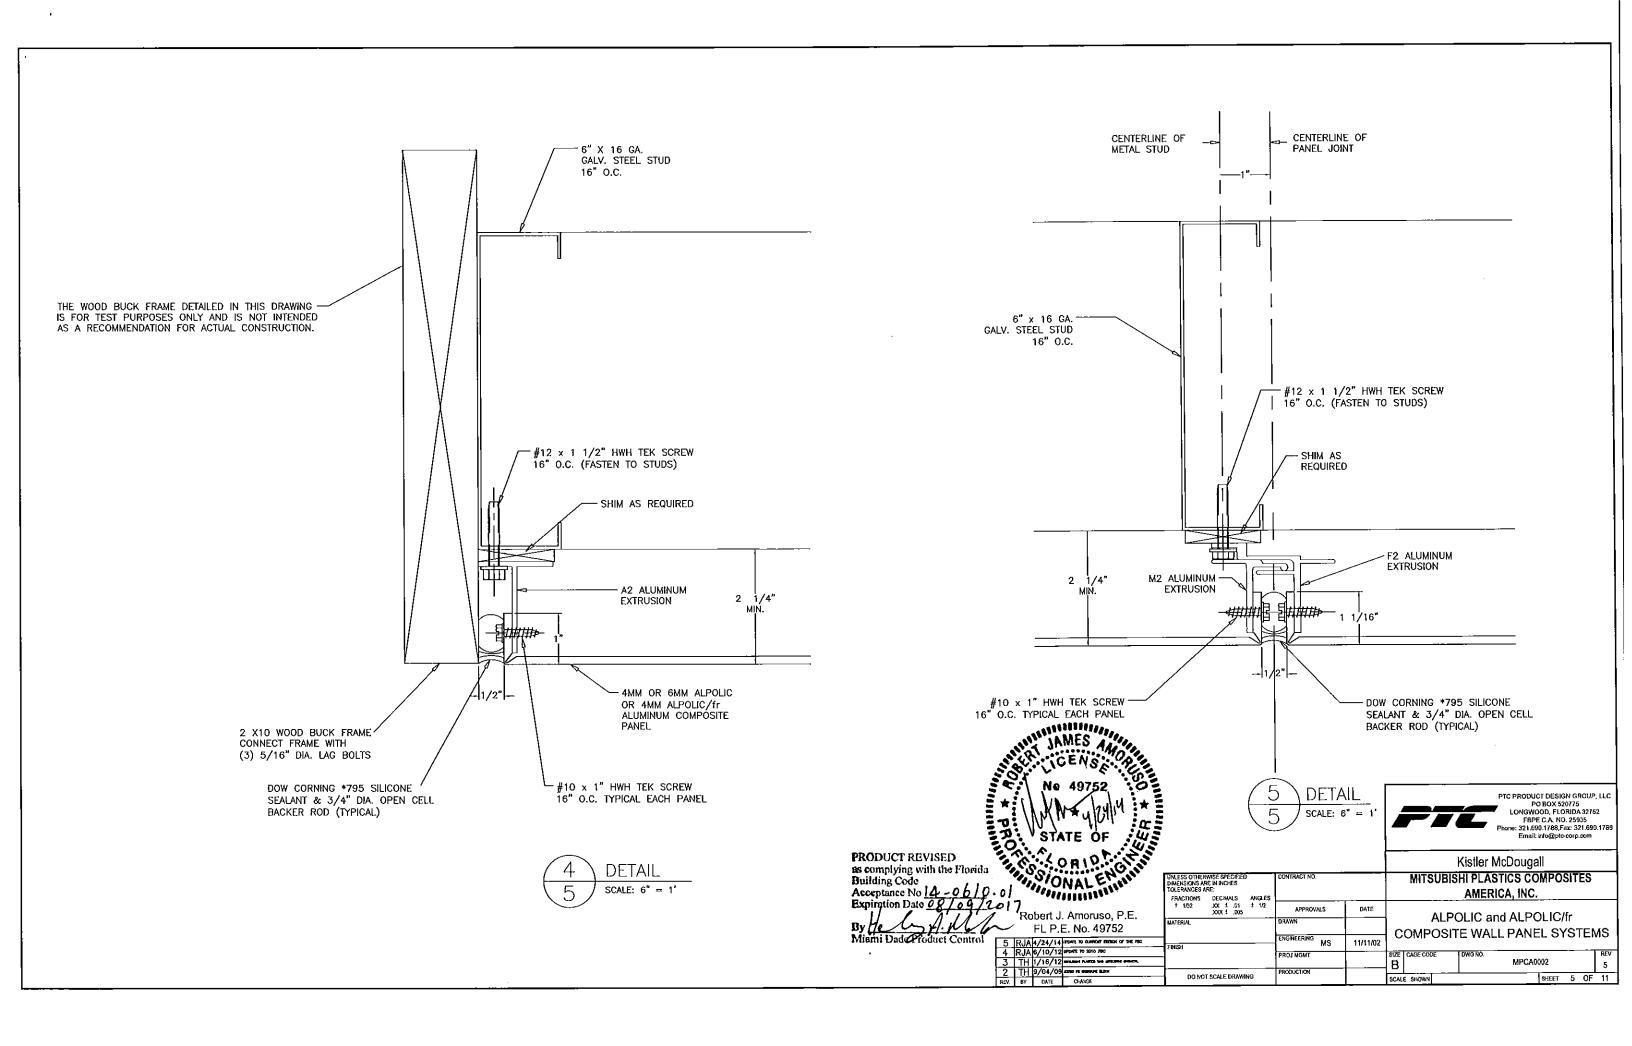

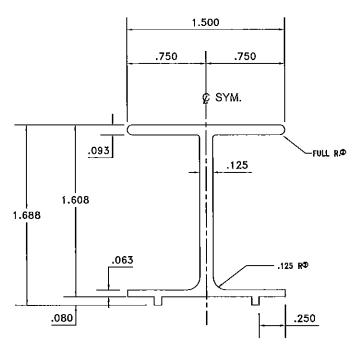

BREAK CORNERS .015 R

EXCEPT AS NOTED

ACTUAL SIZE

DIE DATA

EST. AREA: .430 EST. WEIGHT: .516 DIE SIZE: 6 NO. HOLES: 1


EST. PERI.:

EXT. LENGTH:  $5 \frac{1}{8}$ " = 1 @ 35'

FACTOR:

R/R:

HR

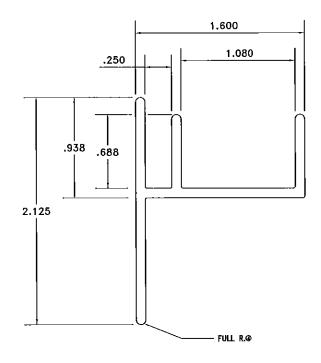

# BREAK CORNERS .015 R .090 TYPICAL METAL THICKNESS ACTUAL SIZE

DIE DATA

EST. AREA: .465

DIE SIZE: 6

EST. WEIGHT: .558


NO. HOLES: 1

EST. PERI.: FACTOR:

EXT. LENGTH: 5 1/8 = 1 @ 36'

R/R

<u>A2</u>



BREAK CORNERS .010 R
.100 WALL THICK TYPICAL
ACTUAL SIZE

DIE\_DATA

EST. AREA: .317

DIE SIZE: 6 NO. HOLES: 1

EST. WEIGHT: .380 EST. PERI.: 6.54

EXT. LENGTH:

FACTOR: 17

R/R: 5 1/8 = 1 @ 53'



Robert J. Amoruso, P.E. FL P.E. No. 49752

FL. P.E. No. 49752

5 RJA4/24/14 (Park to the quark detent of the the R.J.A 6/10/12 (Park to the tike)

3 TH 9/04/09 strained plates via retrieve dedicate (Park to the strain of the tike)

2 TH 6/01/11 downs fr significe react

PRODUCT REVISED
as complying with the Florids:
Building Code
Acceptance No 4-06/0.01
Expiration Date 08/09/2017

By A. M. Mirmi Date Product Complexity



SCALE SHOW?

Kistler McDougall

ALESS OTHERWISE SPECIFED
MENSIONS ARE IN INCHES
SZERVICES ARE INCHES ARE

DO NOT SCALE DRAWING

MITSUBISHI PLASTICS COMPOSITES


AMERICA, INC.

ALPOLIC and ALPOLIC/fr

ALPOLIC and ALPOLIC/fr
COMPOSITE WALL PANEL SYSTEMS

SHEET 6 OF 11

MPCA0002

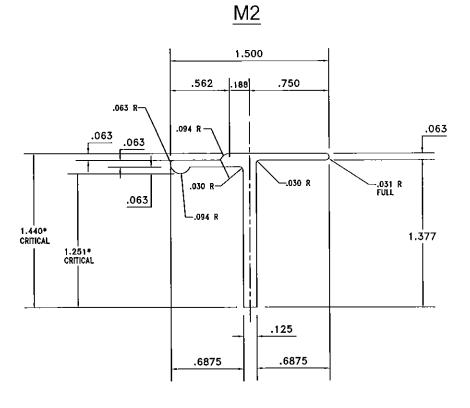

ACTUAL SIZE BREAK SHARP CORNERS .005 R

#### DIE DATA


EST. AREA: .275

DIE SIZE: 6 EST. WEIGHT: .330 NO. HOLES: 1

EST. PERI.: 5.831

EXT. LENGTH:  $4 \frac{1}{2} = 1 - 46$ ' R/R:  $5 \frac{1}{8}$ " = 1 - 62'

FACTOR: 18

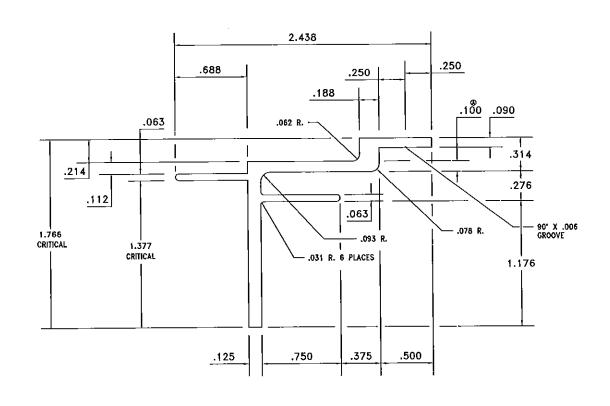

# ACTUAL SIZE BREAK SHARP CORNERS .010R


### DIE DATA


DIE SIZE: 6 EST. AREA: .484


EST. WEIGHT: .581 NO. HOLES: 1


EXT. LENGTH: 5 1/8 = 1@34EST. PERI.: 9.900 R/R


FACTOR: 17

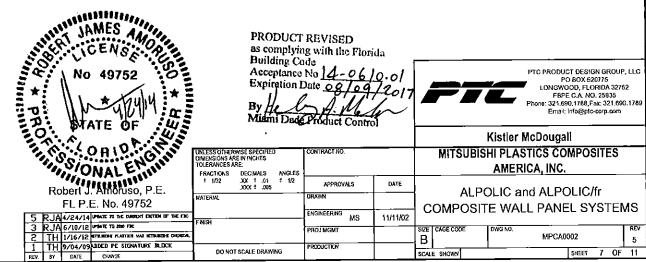

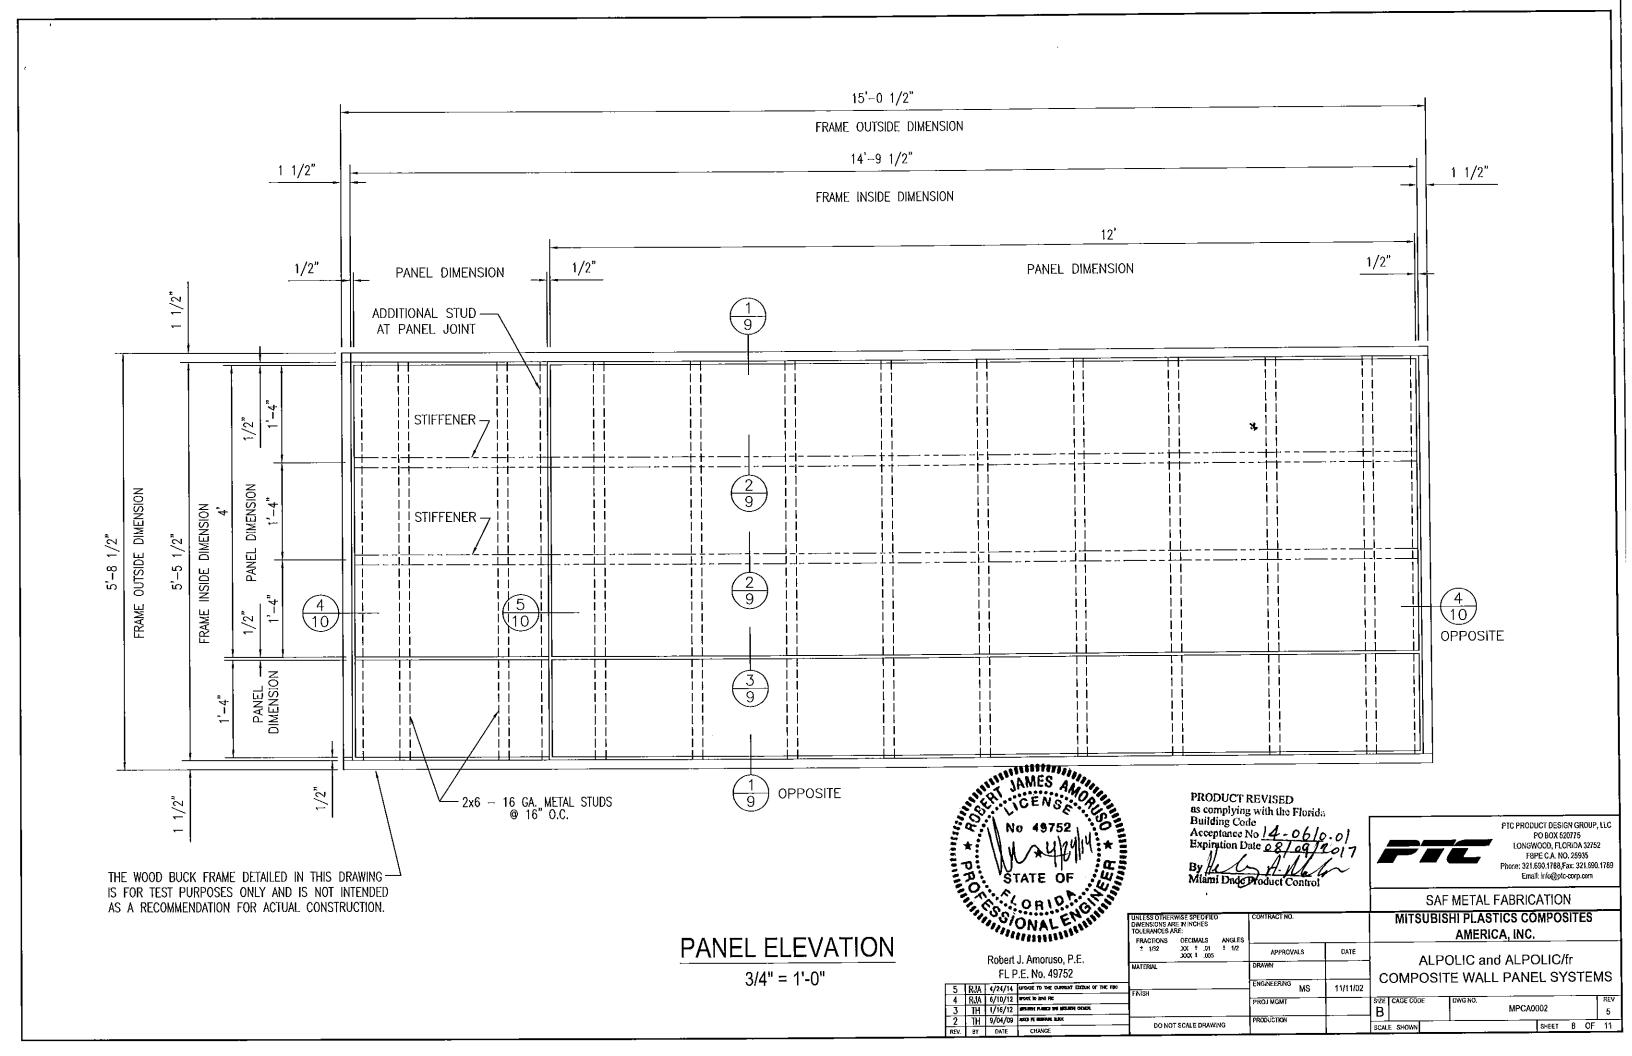

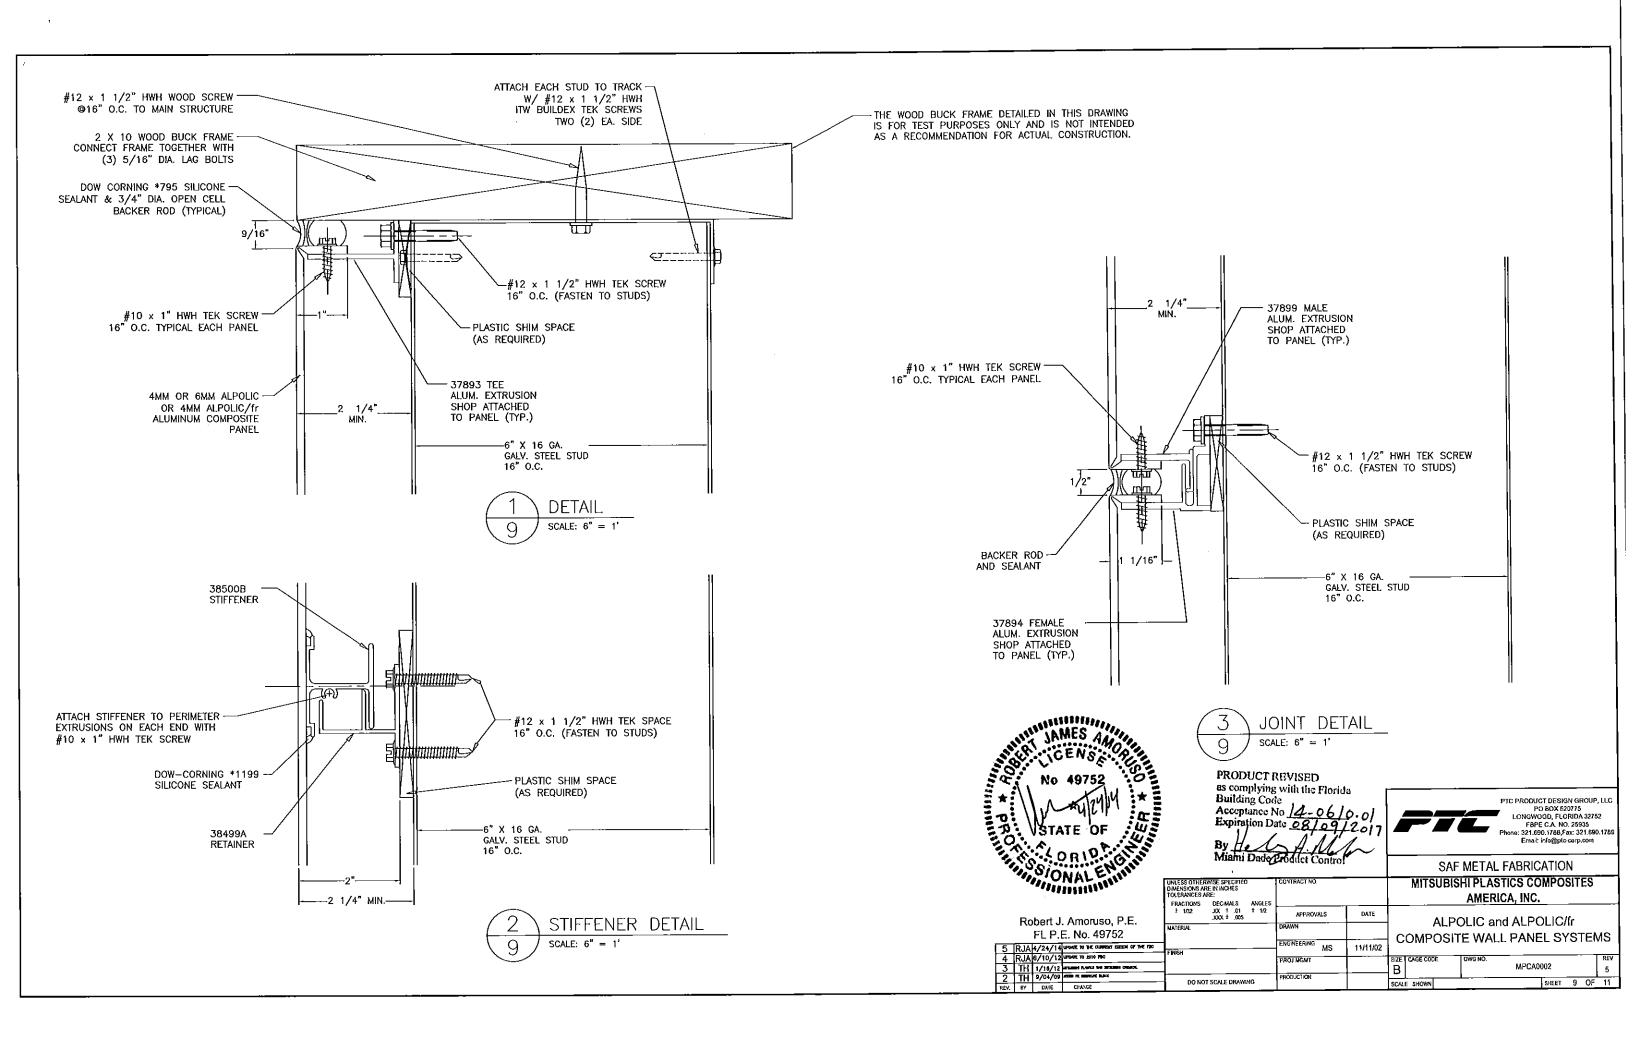

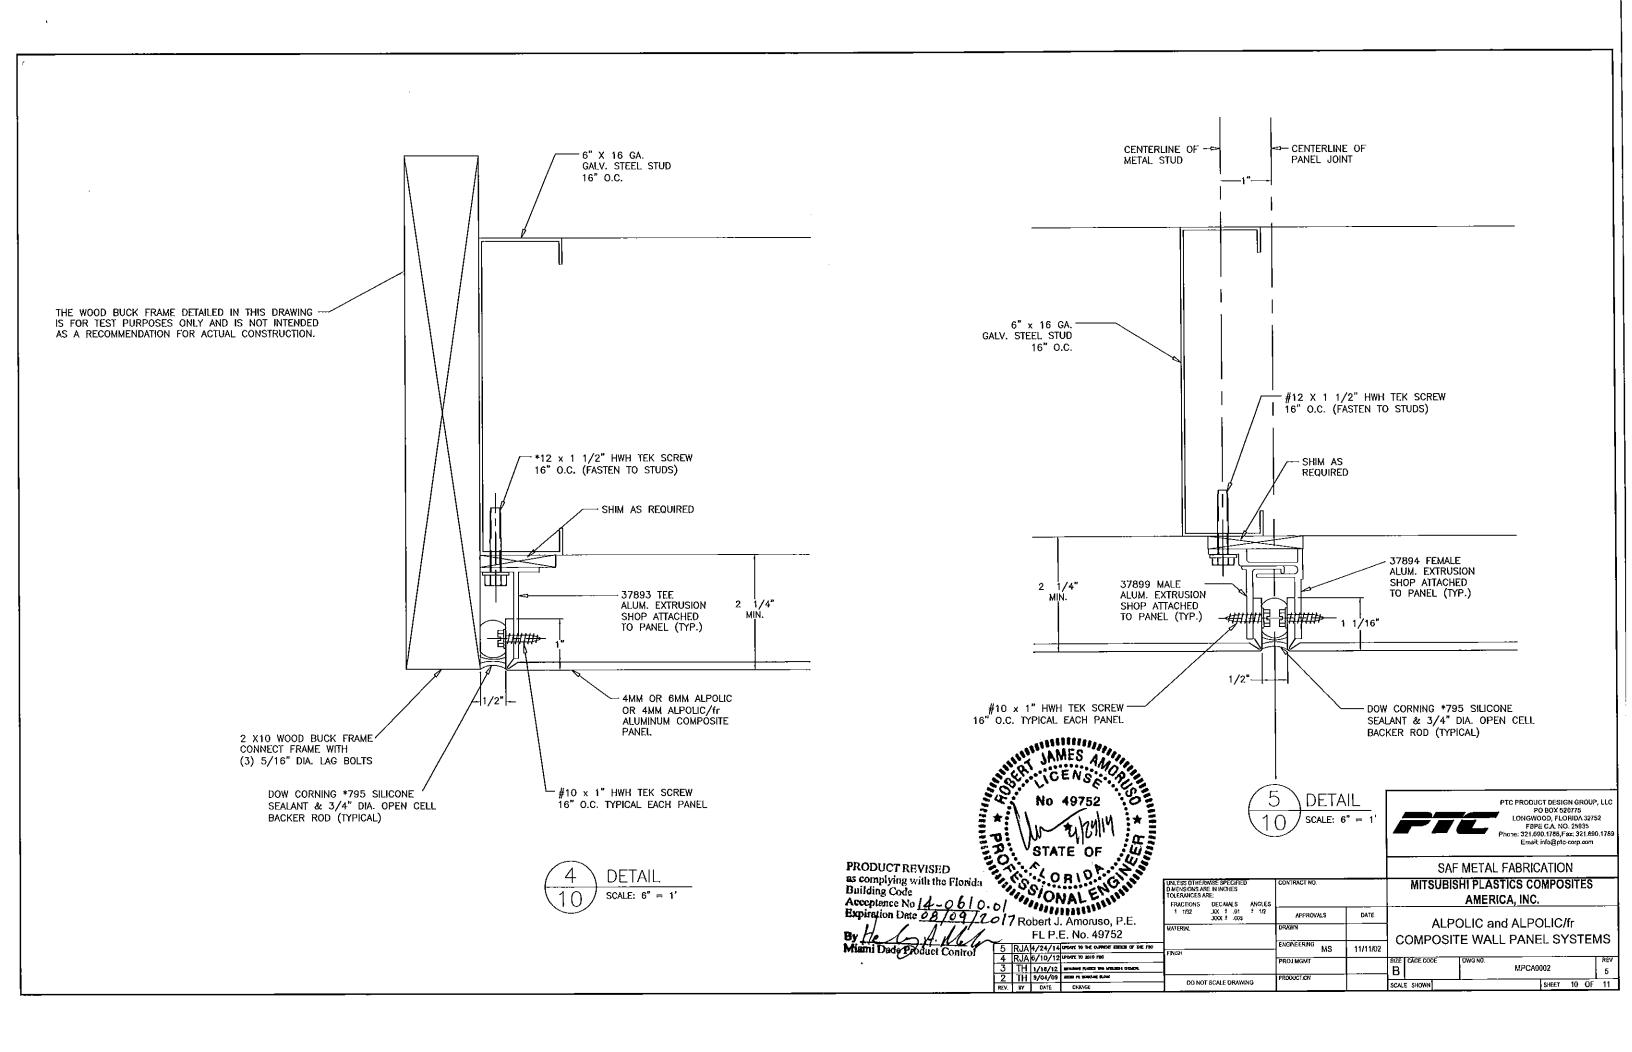




# **ACM TERMINATOR**

**EXTRUDED ALUMINUM 6063-T6** 

Die Data: #SAF-37893

Area = .265
Wt./Ft. = .318
Perim. = 5.483
Circle Size = 0-3

Ix = .078, Iy = .011
Sx = .070, Sy = .018
Cgy = 1.116, Cgx = .628

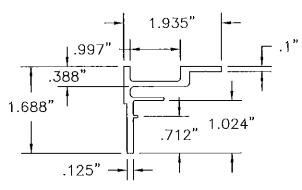


# **ACM FEMALE**

EXTRUDED ALUMINUM 6063-T6

<u>Die Data: #SAF-37894</u>

Area = .499 Wt./Ft. = .599 Perim. = 9.154 Circle Size = 0-3


lx = .100, ly = .161 Sx = .086, Sy = .120Cgy = 1.160, Cgx = 1.348



# RETAINER

**EXTRUDED ALUMINUM 6063-T6** 

Die Data: #SAF-38499A Area = .4610 Wt./Ft. = .542 Perim. = 9.4387 Circle Size = 0-3 Ix = .095, Iy = .1262 Sx = .09, Sy = .117




# **ACM MALE**

EXTRUDED ALUMINUM 6063-T6

Die Data: #SAF-37899

Area = .234Wt./Ft. = .281Perim. = 4.646Circle Size = 0-3 1x = .039, 1y = .012 1x = .048, 1x = .048 1x = .048, 1x = .0481x = .048




# PANEL STIFFENER

**EXTRUDED ALUMINUM 6063-T6** 

Die Data: #SAF-38500B

Wt./Ft. = .390 Perim. = 9.749 Circle Size = 0-3 Ix = .081, Iy = .049 Sx = .120, Sy = .056 Cgy = .676, Cgx = .886

Area = .325



Robert J. Amoruso, P.E. FL P.E. No. 49752

5 RJA 4/24/14 LEPANTE TO COMPOST EXTENS OF THE FIRE
EV. BY DATE CHANGE

CHANGE

CHANGE

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 4-06/0.0/
Expiration Date 98/09/20/7
By Le A. M.

APPROVALS

INGINEERING MS

11/11/02

ATERIAL 4MM & 6MM ALPOLIC & 4MM ALPOLIC/fr

DO NOT SCALE DRAWING



PTC PRODUCT DESIGN GROUP, LLC PO BOX 520775 LONGWOOD, FLORIDA 32752 FBPE C.A. NO. 25935 Phone: 321.590.1788 Emait. info@pto-corp.com

SAF METAL FABRICATION

MITSUBISHI PLASTICS COMPOSITES
AMERICA, INC.

ALPOLIC and ALPOLIC/fr COMPOSITE WALL PANEL SYSTEMS